


KEY PLAN


Scale - 1:350




AND B3 EN 01930-1.2010		
1	VOLTAGE BETWEEN PHASES	132kV
2	MINIMUM CLEARANCE BETWEEN LIVE METAL AND EARTH	1300mm
3	MINIMUM CLEARANCE BETWEEN LIVE METAL OF DIFFERENT PHASES	1300mm
4	MINIMUM TOTAL AIR GAP BETWEEN TERMINALS OF THE SAME POLE OF ISOLATORS	1400mm
5	GAP BETWEEN LIVE AND EARTHED ARCING HORNS OR RINGS	990mm
6	MINIMUM SAFETY CLEARANCE (VERTICAL) BETWEEN LIVE METAL AND POSITIONS TO WHICH ACCESS IS PERMISSIBLE WITH OTHER EQUIPMENT LIVE	3500mm
7	MINIMUM SAFETY CLEARANCE (HORIZONTAL) BETWEEN LIVE METAL AND POSITIONS TO WHICH ACCESS IS PERMISSIBLE WITH OTHER EQUIPMENT LIVE	2900mm
8	MINIMUM CLEARANCE BETWEEN ANY SUBSTATION EQUIPMENT AND THE SUBSTATION FENCE	2000mm
9	MINIMUM INSULATION HEIGHT (PEDESTRIAN CLEARANCE)	2550mm

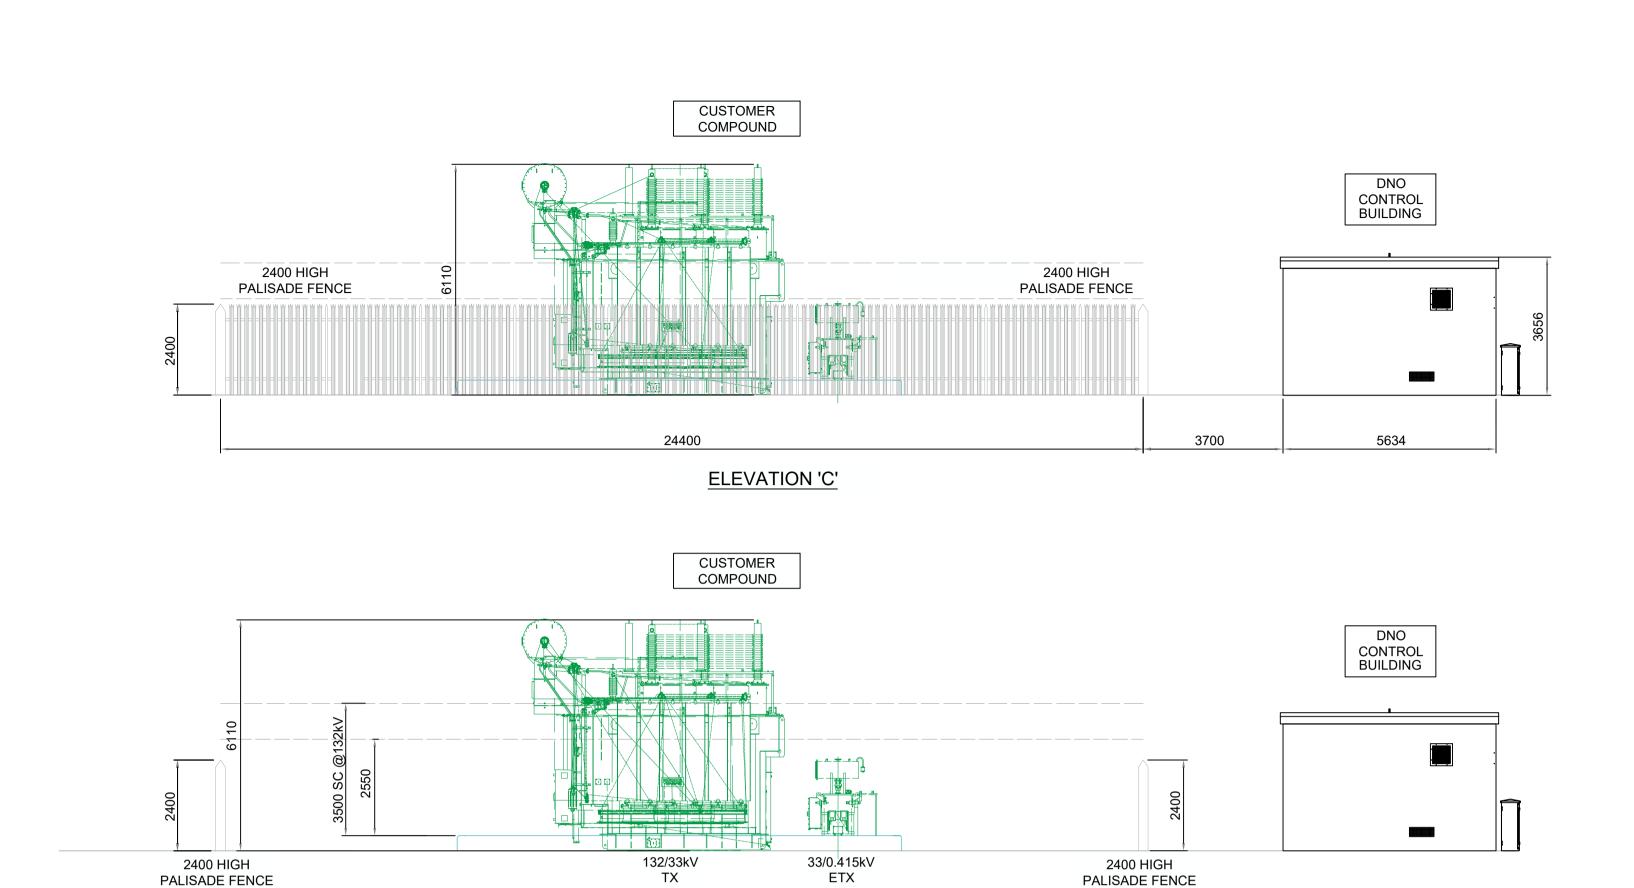


SECTION 'D'-'D'

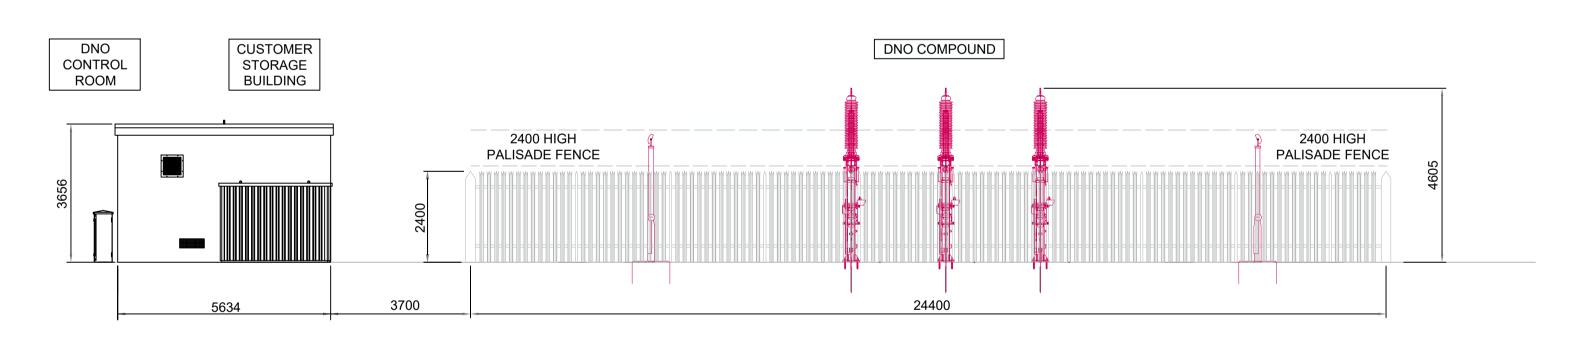

ELEVATION 'E'

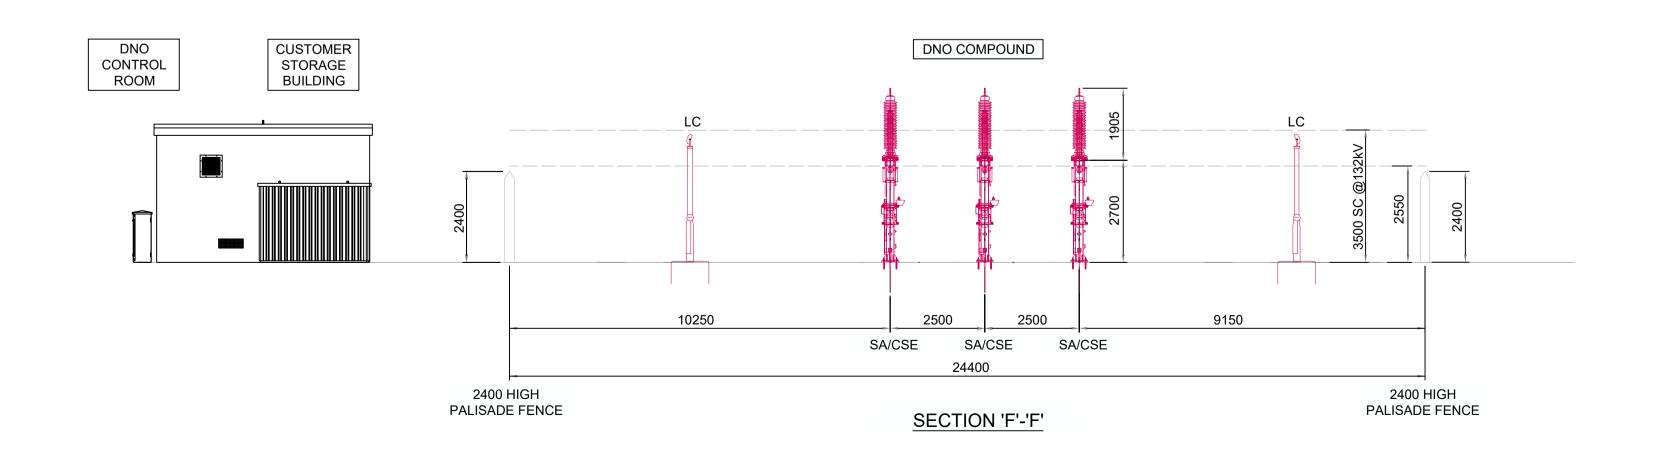

Scale - 1:100



1. THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL RELEVANT ENGINEERS AND SPECIALISTS DRAWINGS & SPECIFICATIONS.

2. ANY DISCREPANCIES BETWEEN THIS DRAWING AND ANY OTHER TO BE REPORTED TO THE ENGINEER IMMEDIATELY.

3. ALL WORKS TO COMPLY WITH THE MOST CURRENT BRITISH

STANDARDS.

4. ALL DIMENSIONS IN MILLIMETERS UNLESS STATED

OTHERWISE. USE FIGURED DIMENSIONS ONLY.

5. ALL DIMENSIONS TO BE ±3mm UNLESS SPECIFIED

OTHERWISE.

6. A RECESSIVE COLOUR SUCH AS GREY IS PROPOSED, BUT CAN BE AGREED WITH OFFICERS.

LEGEND:

LC

NEW DNO EQUIPMENT

NEW CUSTOMER EQUIPMENT

NEW FOUNDATIONS

LC LIGHTING COLUMN - 3m MID HINGED

Project: Newfields Farm BESS Drawing name: Elevations and Sections of 132kV Metering Substation 88-10-05-PL-SS-ELV-02 19.02.2025 R.05 Acoustic Fence Removed R.04 Acoustic Fence Added 12.04.2024 R.03 Text Related to Scaling Modified 19.01.2024 R.02 Sections Modified 13.03.2023 R.01 Scale Bar Added 05.10.2022 R.00 First Issue 21.03.2022 ne: Electrical Phase: FOR PLANNING Format: A1 Scale: Sheet No. 02 / 03

Client: RE Project Development Limited



28 E Samokov str. 1113 Sofia, Bulgaria info@renergy-bg.com www.renergy-bg.com

RENERGY LTD

This drawing may not be reproduced or be made available to third person or competing companies without Renergy permission. The reproduction, distribution and utilization of this document as well as the communication of its contents without explicit authorization is prohibited. Offenders will be held liable and can findes up to 50% of the project cost: variations in design can occur to site conditions.